

# SHINZ<sup>®</sup>

Innovating Future

LEAD YOUR WAY OUT  
FROM THE DARK

## SK-15E

COMBO EXIT SIGNS



Reference Standard

MS 983:2004,

MS 619-2-22:2005

(IEC 60598-2-22:1997 and Amd.  
1:2022, MOD)

MS2687:2018 SECTION 1.5.2.3

LiFePO<sub>4</sub>



# TECHNICAL CHARACTERISTIC

|                                |                                                                                        |
|--------------------------------|----------------------------------------------------------------------------------------|
| Series                         | : SK-15E                                                                               |
| Model                          | : SK-15E1 / SK-15E2 / SK-15EWP                                                         |
| Mode of Operation              | : Maintained Mode                                                                      |
| Input Voltage                  | : AC240V~                                                                              |
| Input Wattage                  | : 3.40W                                                                                |
| Input Current                  | : 0.015A                                                                               |
| Frequency                      | : 50Hz                                                                                 |
| Lamp Type - SIGN               | : 26 x 1 Watt (26Watts)                                                                |
| Lamp Type - FLOOR              | : 1 X 3 Watt                                                                           |
| Power Factor                   | : 0.94                                                                                 |
| Charger                        | : Solid State Electronic Automatic                                                     |
| Charger Monitor                | : Permanent Red LED on                                                                 |
| Test Monitor                   | : Red LED Flashing (Refer Fig.A)                                                       |
| Fault Monitor                  | : Green LED Flashing (Refer Fig.A)                                                     |
| Test Facility - Manual (E1)    | : Push-To-Test Switch                                                                  |
| Test Facility - Automatic (E2) | : Automatic Testing                                                                    |
| Battery Type                   | : 3.2VDC 1500mAh High Temperature Sealed Lithium Iron Phosphate (LiFePO <sub>4</sub> ) |
| Back Up Duration               | : 3 hours                                                                              |
| Operating Temperature          | : ta 35°C                                                                              |
| Weight                         | : 1.5kg                                                                                |
| Mounting                       | : Wall / Ceiling                                                                       |
| Degree of Protection           | : IP20 / IP65                                                                          |
| Fitting Construction           | : Electro Galvanised Steel Sheet with Epoxy Powder Coating                             |
| Warranty                       | : 2 -5 Years (Terms and Conditions apply)                                              |
| Dimensions                     | : Refer to Fig.B                                                                       |
| Installation Guide             | : To be provided in individual packing.                                                |
| Operation Manual               | : QR code provided at Installation guide                                               |
| Reference Standard             | : MS 983:2004, MS 619-2-22:2005<br>(IEC 60598-2-22:1997 and Amd. 1:2022, MOD)          |



Figure A

## STATUS INDICATIONS FOR SK-15E EL-T ( AUTOMATIC TESTING )

| LED Indication     | LED Figure | Status                   |
|--------------------|------------|--------------------------|
| Red Permanent On   |            | Charging                 |
| Red Flash @1Hz     |            | Funtional Test - Monthly |
| Red Flash @3Hz     |            | Duration Test - Yearly   |
| Green Flash @1Hz   |            | Battery Fault            |
| Green Flash @3Hz   |            | Led Fault                |
| Green Flash > @3Hz |            | Battery & Led Fault      |

Note :  
The Yearly Duration Test is a partial discharge test to determine the condition of the battery and therefore the test duration is set at ~90 minutes. If the duration test fails a proper test and inspection shall be conducted by the maintenance personnel.

Figure B

## PRODUCT DIMENSIONS

|        |        |        |               |
|--------|--------|--------|---------------|
| LENGTH | 560 MM | WIDTH  | 37 MM / 43 MM |
| HEIGHT | 161 MM | WEIGHT | 1.1 KG        |



\* All informations are subject to change without prior notice

# SK-15E

## LEAD YOUR WAY OUT FROM THE DARK

New **SK-15E** series with an ultimate designed to provide combination of Keluar Signs and emergency light that illuminating the safety sign pictogram and as well as spaces on the floor. This **Combo Exit Sign** meets the MS2687:2018 which is necessary to identify and needed to be highlighted to ensure people do not trip or fall during evacuations.

With this series we designed 2 versions of testing facilities which are **Manual** and **EL-T** (Automatic Testing) to accommodate the needs and wants from different segment of industry. An EL-T versions will be values added and ease of maintenance.



### What is a Combo Emergency Light / Exit Sign?

Exit Sign / Emergency Light Combo provide the functionality of egress signage ("exit signs") with emergency egress lighting in one easy to install unit. And yet, exit signs play a vital role for all sorts of buildings. Although we rarely think about it, emergencies can strike at any moment. In those situations, you must know how to exit the building safely.

You've seen them so often that you probably don't notice them. After all, what are the chances you'll ever need to see them? That's why a Combo Exit Light is becoming so critical. In an emergency like a fire, people's visibility often becomes impaired. Other times, the power could go out in a building, making an LED exit emergency sign incredibly helpful.



EL is short for "Emergency Lighting", the extra "T" in EL-T stands for "Automatic Testing". This means, EL defines the basic requirements that are relevant for all emergency lighting control gear, EL-T includes all of these basic requirements plus some additional ones that are relevant for automatic testing.

EL and EL-T are self-compliance marks. They confirm that emergency lighting control gear comply with all the relevant standards. Like the CE mark, EL and EL-T work as self-compliance mark. This means that the manufacturer is responsible for putting on the mark. The marks can be used without further investigation through an external certification body.

### How does self-test emergency lighting work and why is it increasingly important for end-users?

Self-test emergency products can reduce the burden of testing emergency lighting installations as these perform all mandatory testing automatically, removing the need for the user or building owner to perform manual testing. The luminaire performs its own functionality test and an LED indicator on the device draws attention to any issues.

Monthly functional tests and annual full duration tests are automatically initiated with results shown via an LED indicator on the indicating light. The responsible person need only check the status of the LED indicator and record the results in the log book. This still requires manual checks / physical walk-arounds and it also requires manual and reactive rectification work.

#### Testing Requirements



Not only is this a far less time-consuming and lower-cost operation than with manual testing, it also ensures that maintenance personnel are only required to attend to lights with reported faults. Where a fault is identified the LED indicator will report (Blink) what is at fault and continue to report (Blink) this until the fault has been rectified.

### SPECIFICATIONS FOR INTERNALLY ILLUMINATED 'KELUAR' SIGNS



- Self-Contained internally illuminated 'Combo Keluar Sign' (EL-T) system with maintained mode of operation that comes with high Temperature Sealed Lithium Iron Phosphate (LiFePO<sub>4</sub>) Battery to back up 3hours. Batteries shall comply to safety (IEC 62133:2012) and performance (IEC 62620 :2014) standards. The Self-contained Keluar Signs shall manufactured to meet and comply to MS IEC 60598-1:2006 and both MS 983:2004 & MS 619-2-22:2005. The Emergency luminaires (EL-T) shall provide Functionality Test on Led source, Inner charger & Switch over control monthly and yearly Duration Test for battery.
- The Shinz **SK-15E** (EL-T) fitting is constructed using **Electro Galvanised Steel Sheet with Epoxy Powder Coating** with IP20 that is suitable for indoor applications such as exit ways on escape route, anti panic areas and hazardous areas.

# EXIT SIGN – KELUAR SIGNS

*'Indicate Escape Direction Clearly - Even In Changing Emergency Conditions'*

Illuminated exit signs with a built-in lamp incorporate a pictogram - such as the iconic 'green running man' - indicate a fire exit or other safe escape direction. The pictogram is illuminated from behind to provide luminance to at least requirements MS IEC60598-2-22 & EN 1838.

## Breaking new ground

There are a number of important developments in exit signs, from minimizing their environmental impact to minimizing their visibility. **Adaptive technology** now enables signs to dynamically change indicated direction to improve evacuation efficiency depending on conditions detected by the emergency lighting management system or control room operator.

The bright, uniformly-lit appearance of today's **clean, flat profile designs with no visible screw heads** enable designers to combine good looks with fail-safe functionality.



## WALL-MOUNTED

Wall-mounted exit signs are available to cover a range of locations and in various mounting options, including surface, recessed and flag. Single- and double-sided variants, as well as different viewing distance specifications, make wall mounted signs a flexible option for a wide variety of room sizes and applications.



## CEILING

The comprehensive range of exit sign luminaires suitable for **ceilings** includes surface-mounted, suspended and recessed units. Single- and double-sided variants, as well as different viewing distance specifications are also available for ceiling mounted signs.




## COMBINATION SIGNS

Combination signs perform two functions: illuminating the safety sign pictogram on one or two sides, as well as surfaces and spaces.


## REFERENCING TO EN1838 / MS2687:2018 GUIDELINES - (MVD)

**Maximum Viewing Distance (MVD)** and luminance conditions are detailed for safety sign formats in EN1838:2013. Signs can either internally illuminated or non powered type. Non powered Exit Signboards including photo-luminescent signs need to be illuminated to minimum of 5 lux whenever premises are occupied. Therefore, an emergency luminaire must be sited within 2 meter.

The internally **illuminated KELUAR signs** shall be positioned as required mounting height between 2 m and 2.5 m above floor level. If this is not possible, the relevant authority should be consulted.

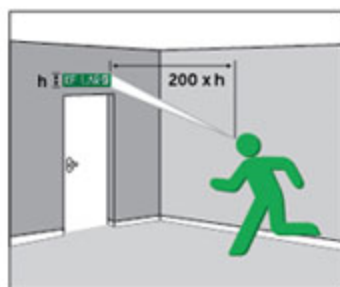

Maximum viewing distance  
For internally  
**Illuminated Signs**  
 $d (h \times 200)$

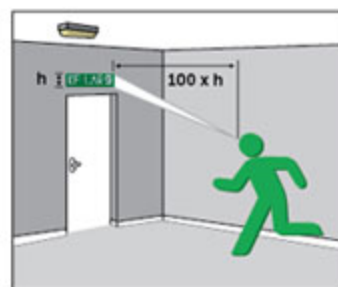

Maximum viewing distance  
For  
**Externally Signs**  
 $d (h \times 100)$

The dimensions of graphical symbol signs shall be tested in accordance with MS619-2-22:2005 and MS IEC 60598-1:2012. The MS 2687:2018 Clause 13 where Keluar Signs required locations shall be as follow:

1. At the point of entry to every protected passage, protected lobby or fire escape staircase leading to the final exit (exit route).
2. KELUAR/Pictorial sign indicating the location/direction of the exit route shall be placed not more than 30 m apart in public areas.
3. At the point of exit to every shop/compartment leading to public area except where the shop/compartment area is less than 30 m square or where the distance from the most remote point in the shop/compartment to the exit is less than 6 m.

*'Most people will try and leave a building the way the came in'*

The building owners or specifiers should design the signage which indicates the shortest escape route. As a result, Exit Signs with arrow sign such as left arrow, right arrow, straight forward arrow and double-sided arrows are needed where necessary.




# RECOMMENDED SIGNAGE

Time is of the essence during evacuation, this means it is critical that all escape route signage can be quickly seen, understood and followed. Section 4.1 of EN1838:2013 details this point stating that 'Signs which are provided at all exits intended to be used in an emergency and along escape routes shall be illuminated to indicate unambiguously the route of escape to a point of safety'.


|                                                                                   |                          |                                                                                    |                                   |
|-----------------------------------------------------------------------------------|--------------------------|------------------------------------------------------------------------------------|-----------------------------------|
|  | SK-15E-M<br>RUN MAN      |  | SK-15E-SA<br>STRAIGHT ARROW       |
|  | SK-15E-LA<br>LEFT ARROW  |  | SK-15E-DSA<br>DOUBLE SIDED ARROWS |
|  | SK-15E-RA<br>RIGHT ARROW |  | SK-15EWP-M<br>IP65 Weatherproof   |

## SAFETY LIGHTING - POINTS OF EMPHASIS


The following representation highlights key points of emphasis requiring a luminaire :

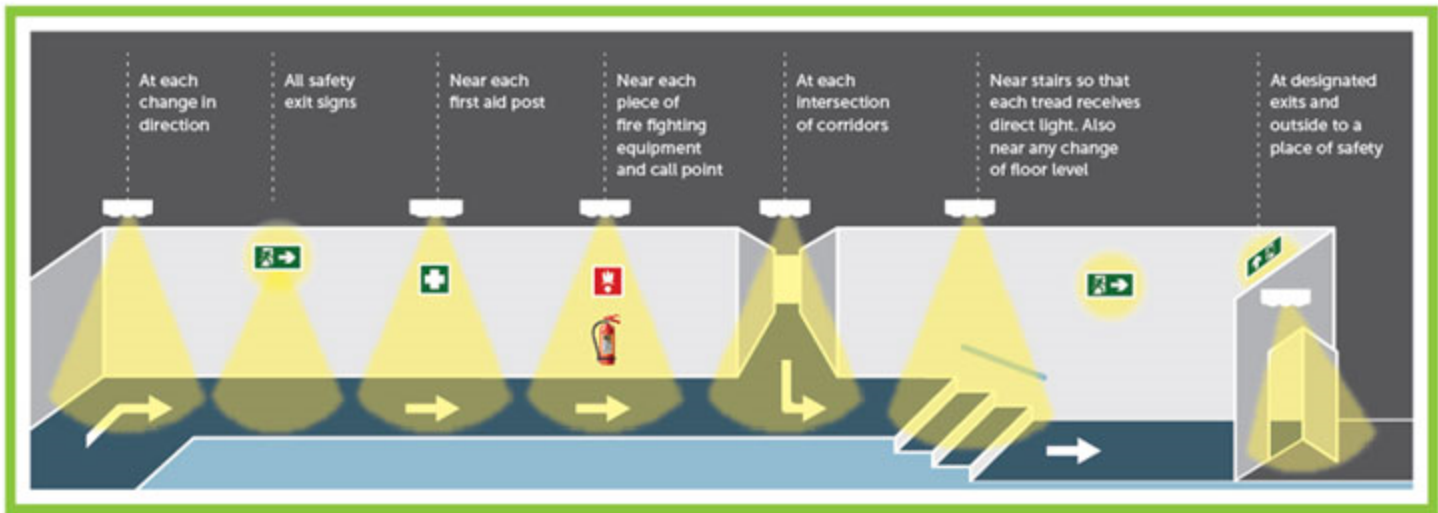


## POINT OF EMPHASIS - KELUAR SIGNS

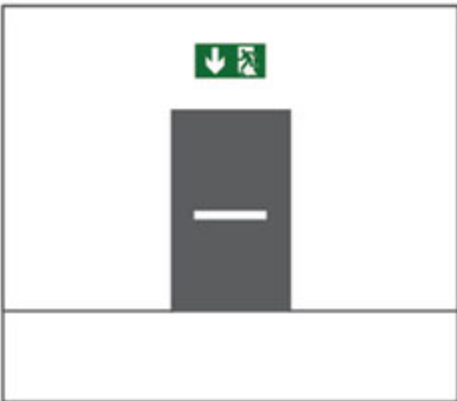

At all exits to be used in the case of an emergency

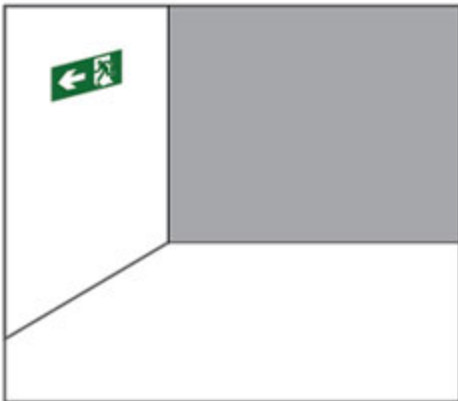

At points that dictate a change in direction

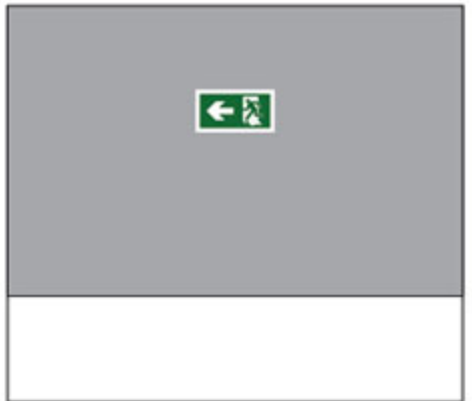

Throughout the corridor

Note : Please contact us or our channel partners for Even Distance Tables for Emergency light on Combo Exit Signs.



**Shinz Global Sdn Bhd** 201401009324 (1085402-M)

No. 5, Jalan BPU 8, Bandar Puchong Utama,  
47100 Puchong, Selangor Darul Ehsan, Malaysia.

Tel : +6 03 5879 0388  
Fax : +6 03 5879 0688  
Email : [shinzglobalchannel@gmail.com](mailto:shinzglobalchannel@gmail.com)  
[ewest.acc@gmail.com](mailto:ewest.acc@gmail.com)

[www.shinzglobal.com](http://www.shinzglobal.com)  Shinz Global S/B